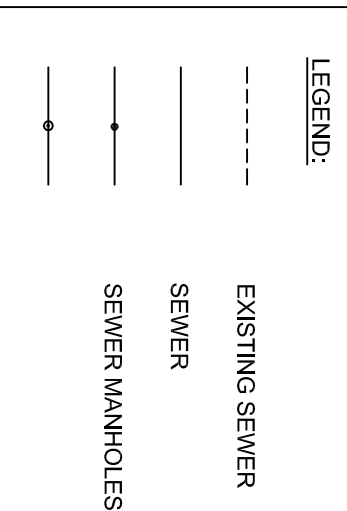


- NOTES:
1. ALL SEWER GRAVITY PIPES TO BE 160mm DIA., PVC HEAVY DUTY, SOLID WALL PIPES (STRUCTURAL WALL STRENGTH 400 MPa).
  2. THE CONTRACTOR MUST USE INVERT LEVELS AS PER UTILITY DRAWINGS.
  3. INSTALLATION OF PIPES TO BE IN ACCORDANCE WITH SABS 1200 LD.
  4. PIPE TRENCHES AND BEDDING TO BE IN ACCORDANCE WITH SABS 1200 DB AND 1200 LB.
  5. MANHOLE TYPES:
    - IN ROAD RESERVES / SHOULDERS - TYPE 2A
    - IN NON TRAFFICED AREAS - TYPE 4(REFER TO MANHOLE AND RIDDING EYE DETAILS)
  6. ERF CONNECTIONS SHOWN ON THE SEWER DRAINAGE SYSTEM LAYOUT ARE SCHEMATIC. (SEE STANDARD DETAILS OF CONNECTION TYPES).
  7. THE CONTRACTOR MUST CONTACT THE LOCAL MUNICIPALITY

[illegible]